

CPRI

TEST REPORT



Central Power Research Institute

(A Govt. of India Society)

P.B.No. 8066, Sadashivanagar Post Office,

Sir C.V. Raman Road,

Bangalore - 560 080 (INDIA)

CENTRAL POWER RESEARCH INSTITUTE



CPRI

TEST REPORT

Test Report Number : CPRI BLREATD1819T0186 **Dated: 23.08.2018**

Name & Address of the Customer : M/s. Manesh Mahabat Batteries Pvt. Ltd.,
Sr. No. 38/1, Khedekar Industrial Estate,
Behind Pari Company, Narhegaon,
Pune - 411 041

Name and Address of the Manufacturer : M/s. Manesh Mahabat Batteries Pvt. Ltd.,
Sr. No. 38/1, Khedekar Industrial Estate,
Behind Pari Company, Narhegaon,
Pune - 411 041

Particulars of sample tested :
Condition of Sample on receipt : New
Type : Tubular Lead-Acid Batteries
Description of test sample : 2 V - 600 Ah @ C10, TBS Batteries
Serial Number : MB6002, MB6007
Number of samples tested : Two
Date(s) of Test(s) : 13.08.2018 to 21.08.2018
CPRI Sample Code No(s). : EATDBAT1819S0056-S0057


Particulars of tests conducted :
Test in accordance with Standard/Specification :

Tests in accordance with IS: 1651-2013 as below	
Clause No.	Tests
12.2 and 6	Verification of constructions requirements
12.3 and 8	Verification of marking
12.4 and 7	Verification of dimensions
12.5	Test for capacity
12.9	Ah & Wh Efficiency
12.10	Test for voltage during discharge

Sampling Plan : Not applicable
Customer's Requirement : As Above
Deviations if any : -Nil-
Name of the witnessing persons
Customers representative : -Nil-
Other than customer's representatives : -Nil-
Test subcontracted with address of the laboratory : None
Documents constituting this report (in words):
Number of Sheets : Five
Number of Oscillogram/s : -Nil-
Number of Graphs : -Nil-
Number of Photos : -Nil-
Number of Test Circuit Diagrams : -Nil-
Number of Drawings : One Only, DRNG No: MMBPL/378, Rev. 00


(KULDEEP SINGH RANA)
Test Engineer

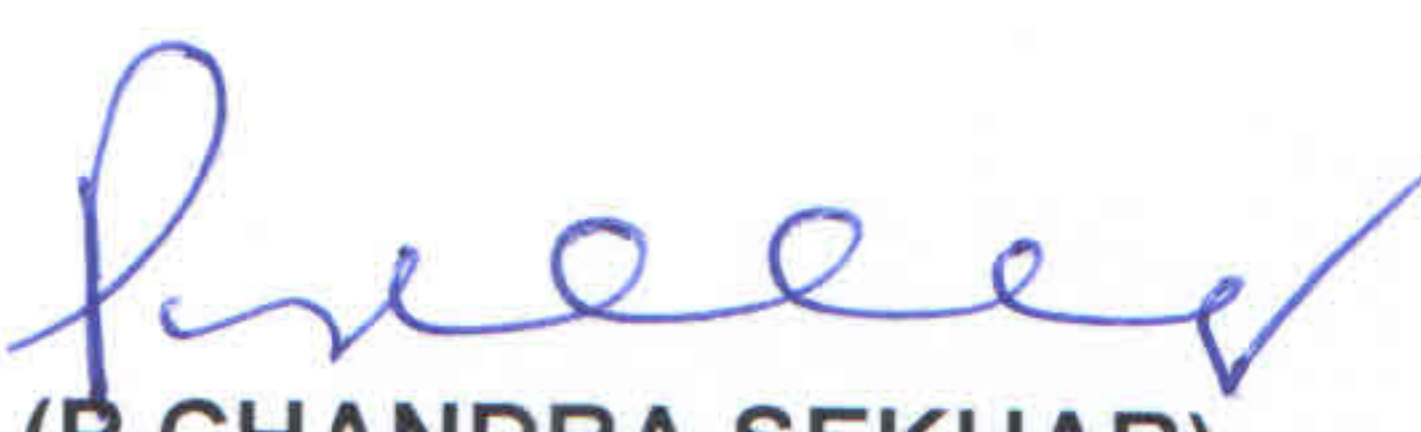


(P CHANDRA SEKHAR)
Head of Division
Approved By